



**REQUEST FOR BIDS  
Public Works Contract  
SPECIFICATIONS AMPHITHEATER POWER REPLACEMENT**

DATE OF RELEASE: July 16, 2021

DATE OF CLOSING: August 2, 2021 at 2:00 pm (cst)

RFB ID: 07162021

**STATEMENT OF PURPOSE:**

The City of Helena, Alabama is hereby posting this Request for Bid for the construction of Replacement Power at Helena Amphitheater Park. The City of Helena will consider bid packages from qualified contractors. Any firm or bid package which is found not in compliance with the RFB specifications and requirements will be disqualified from the bid. Bids shall be sealed and delivered to the office of the City Clerk located at 816 Highway 52 East, Helena, AL 35080 or mailed to P.O. Box 613, Helena, AL 35080 no later than 2:00 pm (cst), August 2, 2021. All bids must comply with Alabama State Law, including but not limited to, Ala.Code (1975) 41-16-50 et seq. and 31-13-9 et seq. and provide documentation of enrollment in the E-Verify Program pursuant to Ala. Code 31-13-9. All bid information must be typed or printed in black ink. Bids shall be clearly marked "sealed bid", along with the bid name, number, and date of opening listed on the outside of the bid package.

**SCOPE OF SERVICES:**

Bid is to include labor, material and equipment For Power Distribution Replacement at Helena Amphitheater

## **SPECIFICATIONS.**

### **POWER DISTRIBUTION AT AMPHITHEATER**

#### **PART 1 -GENERAL**

##### **1.1 DESCRIPTION OF WORK:**

**A. General:** The work to be performed under the division of this contract shall consist of all labor, materials, tools, equipment and perform all work and operations necessary for the complete construction of Power Distribution Replacement at site location.

- Remove existing electrical service behind concession
- Install New 400 amp 120/240v service behind concession Building
- Install New 225 amp 120/240v panel at Mixing Hut
- Install (8) new 50amp Power outlets(50/2 weatherproof locking receptacle/pedestals.)
- Install 6#8 & 2#10(G)-1-1/4"PVC to (2)-50/2 bkrs in panel MP-CS. Provide 1-1"PVC w/pull string to panel MP-CS to 4 locations throughout the park.
- Provide (8) Spyder Boxes CEP-Power Distribution Boxes- CGUJ1
- Provide (8) 100 ft. 50amp extension cords

**B.** The Contractor shall verify that the sub-grade is in satisfactory condition and at proper elevation prior to beginning work on this section.

**C.** Contractor is to confirm that the material and trenching is acceptable to meet all criteria in the contract.

**D.** The Owner will inspect and check the variations and uniformity of the finish grade and request Contractor to correct any deficiencies until they meet the requirements of the specifications. Prior to final acceptance, Contractor shall certify that finish grade conforms to the specifications contained herein.





Existing 200amp feeder from stage power.

Stage power

Existing 200amp panelboard to be removed. Panel "Mixing Hut" (feeder to remain)

RP-CS Existing panel

Concession stand

Existing to remain utility pole mounted transformer.

Existing (2) meters on wooden backboard:  
a. Existing concession meter & panel for concession to be removed.  
b. Existing park meter and panel for park pedestal power to be removed.


Existing panelboard on wooden post to be removed along with all existing circuits associated with it.

Existing electrical pedestals to be removed.

Google Earth


© 2021 Google



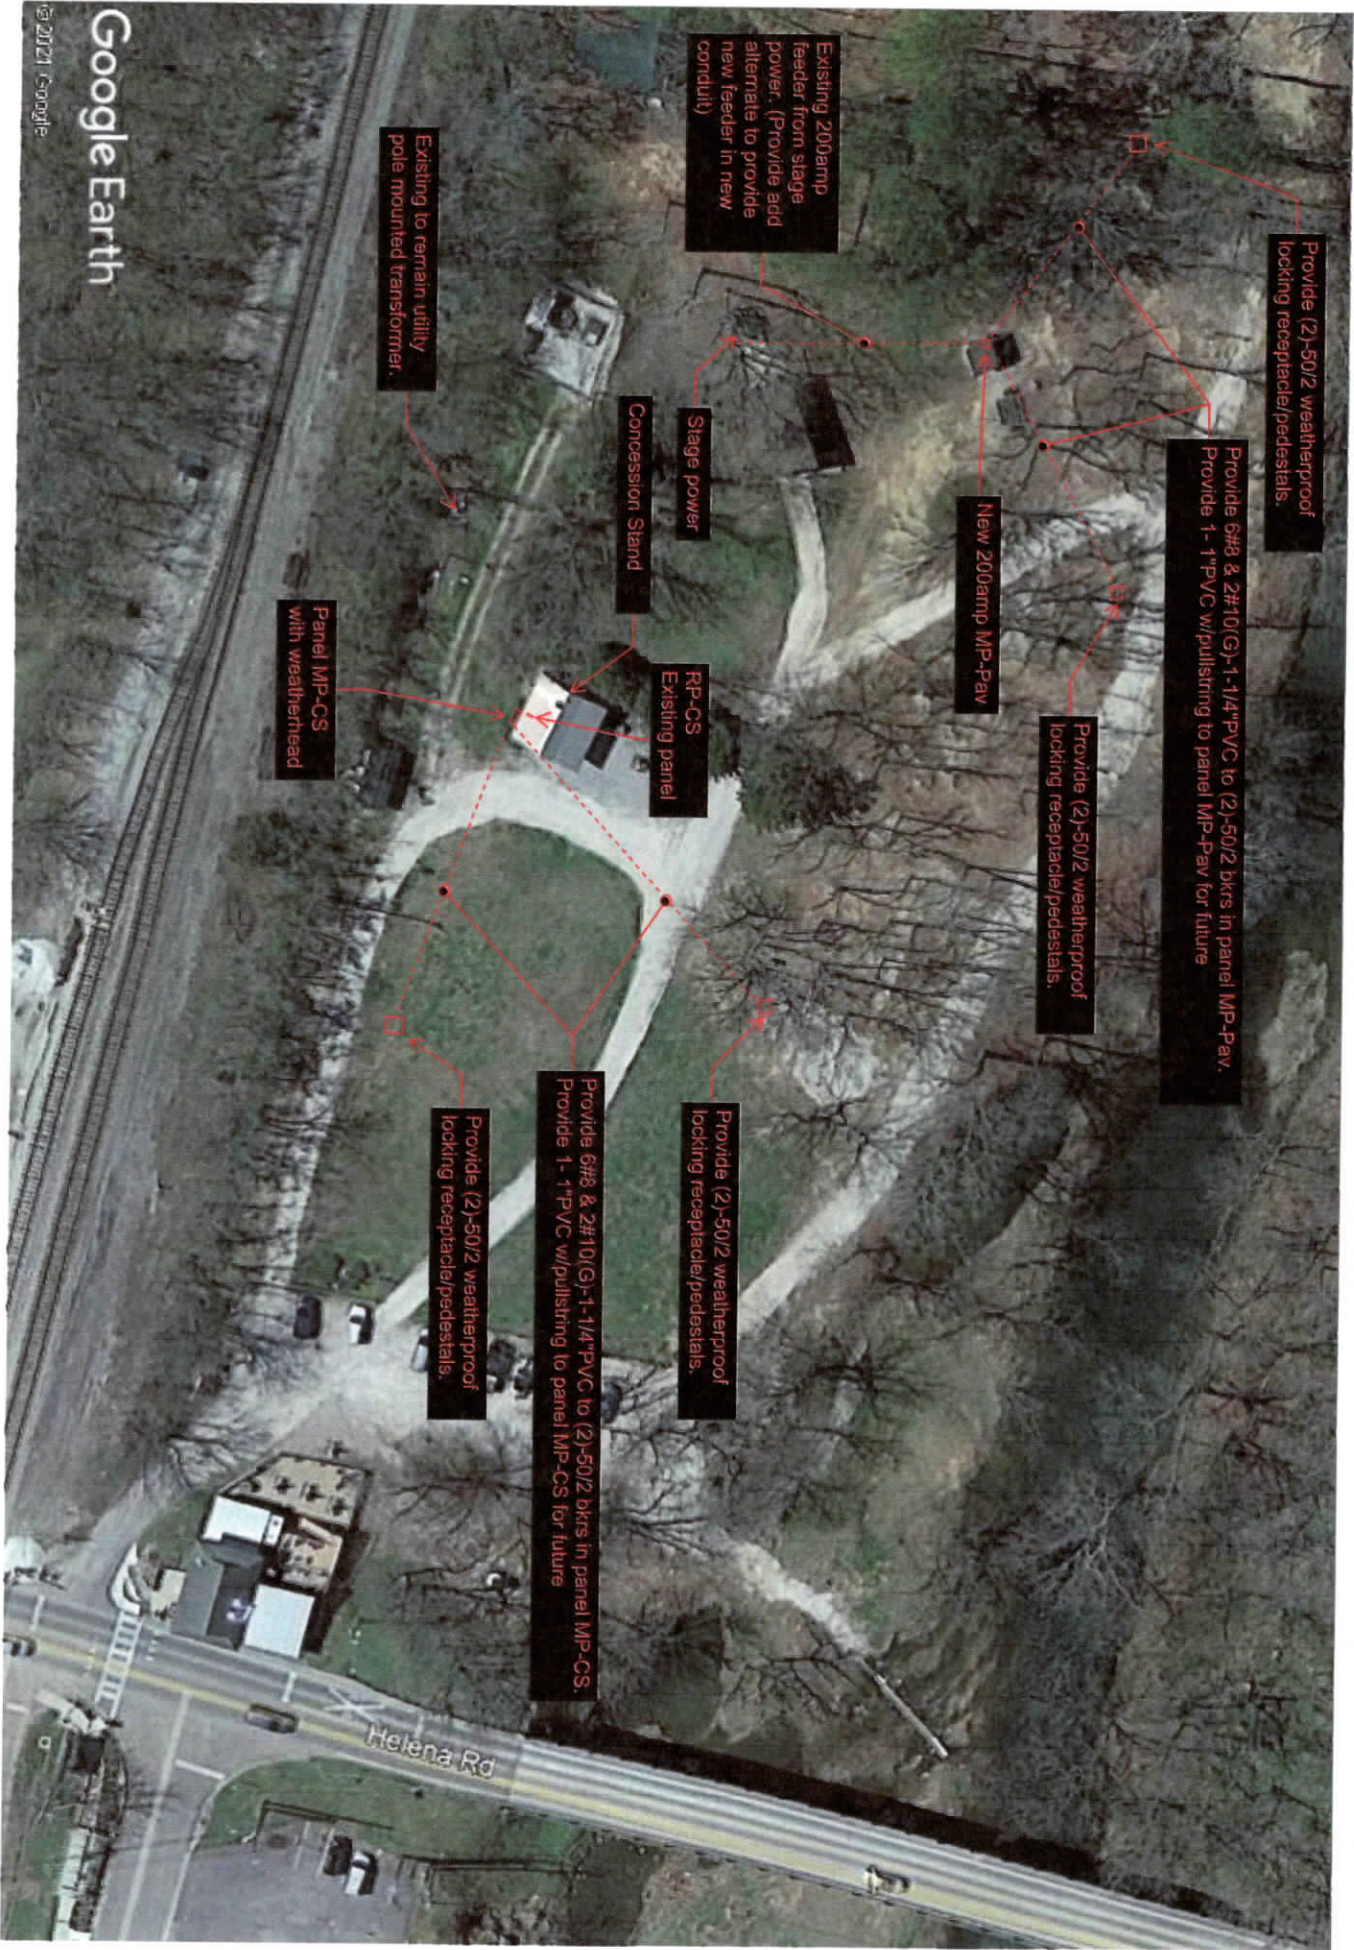


Google Earth

© 2021 Google

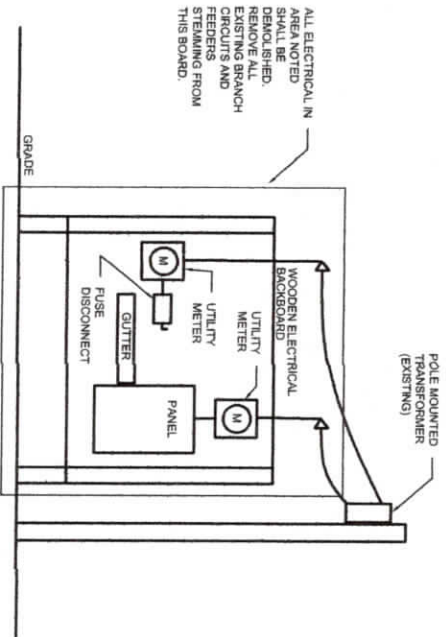

DEMOLITION - PARTIAL RISER DIAGRAM

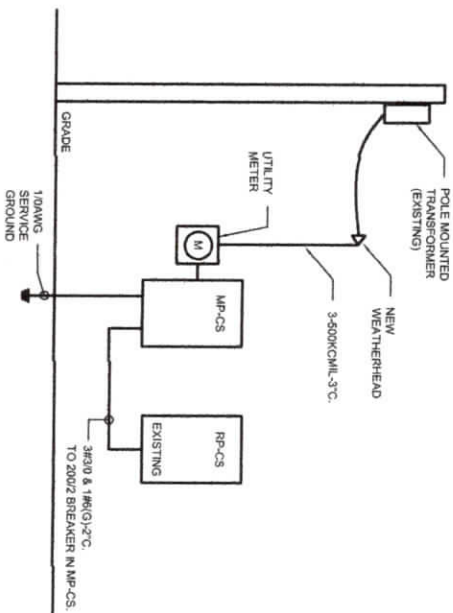

NEW WORK - PARTIAL RISER DIAGRAM


PANEL BOARD : MP-CS  
400AMP MAINBREAKER, 120/240VOLT, 1PHASE PANELBOARD, 10KAIC, WEATHERPROOF.  
BRANCH BREAKERS : (1) - 2002, (6) - 502, (16) - 20/1 BREAKERS.  
PANEL ULSE FOR SERVICE ENTRANCE.

**Power Distribution Boxes and cords:**  
Provide (8) - Power Distribution Boxes, 120/240V, AC Voltage Rating, 50Amps  
Manufacturer : CEP ; Item # 3GUJ1 ; Model Number : 8706GU.  
Provide (8) - 100 foot cords with 50/2 locking devices at each end.  
Webpage : <https://www.graininger.com/product/CEP-Power-Distribution-Box-3GUJ1>

**Panel manufacturers:**  
Square D, Seimens, Eaton or approved equal.

**Conductor manufacturers:**  
Southwire or approved equal : THWN

Preliminary Drawings  
For Pricing Only

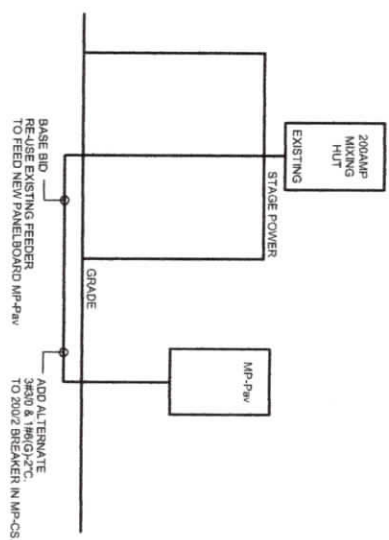

NEW WORK - PARTIAL RISER DIAGRAM

PANEL BOARD : MP-Pw  
200AMP MAINBREAKER, 120/240VOLT, 1PHASE PANELBOARD, 10KAIC, WEATHERPROOF.  
BRANCH BREAKERS : (6) - 502, (18) - 20/1 BREAKERS.

## **BID RESPONSE CONTENT.**

Each bid must use the following format, providing a response to each line item, and include attachments within their bid package.

## **QUALIFICATIONS OF CONTRACTOR.**

1. Bids in excess of \$15,000 will be subject to the bid requirements applicable to State Law, which requires a bid bond of not less than 5% of the estimated cost or of the amount bid, but not to exceed \$10,000. In addition, the winning bidder must furnish a performance bond in amount of 100% of the contract price and a payment bond in the amount of 50% of the contract price.
2. Licensed as required by Title 34, Chapter 8, Code of Alabama, 1975;
3. Provide copy of Alabama General Contractors License.
4. Able to provide a Certificate of Insurance for Comprehensive General Liability, Comprehensive Auto, and Workman's Compensation and the ability to maintain in full force and effect during the entire contract period. Liability limits should be no less than \$1,000,000.00

## **BID QUALIFICATIONS:**

Please provide confirmation and a response to each item listed below.

Statement of qualifications and experience

Number of years engaged in business.

Fully describe your company and experiences.

History of successful and stable company operation for a period of at least (1) year.

List of past and present contracts similar to this RFP within the State of Alabama.

Include names and qualifications of personnel to be assigned to managing this proposed agreement.

The firm is currently licensed, insured, and authorized to conduct business in the City of Helena, Shelby County, and the State of Alabama.

Please attach a copy of all licenses and insurance.

Any questions may be addressed to City of Helena City Clerk, Amanda Traywick 205-663-2161



## SUBMISSION.

Bid packages shall be sealed with (1) master copy and (6) additional copies, and delivered to:

**The City of Helena**

**ATTN: Amanda Traywick, City Clerk**

**816 Highway 52 East, Helena, AL 35080**

All bid proposals must be received no later than the posted deadline of August 2, 2021, at 2:00 pm (cst). Bid packages submitted after the posted date and time will not be accepted. Bid packages must be sealed and clearly marked with the Bid #, title, and the date of bid opening. Proposals may not be withdrawn for a period of (30) days after the closing date. The City of Helena reserves the right to reject any and all bids.

***Please insure that each item is included within your bid package. Failure to provide a complete package of submittals may result in disqualification from the bid process.***

\_\_\_\_\_  
Business Name

\_\_\_\_\_  
Authorized Business Representative Name (Print)

\_\_\_\_\_/\_\_\_\_\_/\_\_\_\_\_  
Authorized Business Representative Signature Date of Submission

## REQUEST FOR BIDS

**City of Helena**

**SPECIFICATIONS FOR AMPHITHEATER PARK POWER REPLACEMENT**

DATE OF RELEASE: July 16, 2021 at 8:00 am (cst)

DATE OF CLOSING: August 2, 2021 at 2:00 pm (cst)

RFB ID: 07162021

### **Bid Submission:**

Contractor: \_\_\_\_\_

Construction of Bollard Boundary: \$ \_\_\_\_\_

Business Name

\_\_\_\_\_  
Authorized Business Representative Name (Print)

\_\_\_\_\_/\_\_\_\_\_/\_\_\_\_\_  
Authorized Business Representative Signature Date of Submission